


Features & Benefits

- Automatic control and power distribution for deicing and snow melting
- Integrated electronic controller with backlit LCD display
- User friendly interface
- Up to 3 zones activation
- Interface to B.M.S and Smart-Home using BACNET and MODBUS over RS485 communication wires
- Sequencing option between the zones Allowing larger snow melting area with less available power on site
- Multiple snow sensors inputs optional with Aerial, Ground, Gutter or 3rd party input.
- Master/Slave capability connecting several PYROBOX units to work together

- Critical zones settings these areas will be heated whenever it is snowing while other zones will stagger
- Up to 600V & 300A outputs to heaters
- Integrated adjustable Ground Fault Sensor
- Adjustable Temperature set-point, Upper and Lower Limit Temperature
- Adjustable Hold-On-OFF Delay and Manual On
- Adjustable splitting time between the zones with multi configurations between zones
- Technician testing / commissioning mode for easy and fast system test all year long (even during summer or at high temperatures)
- Energy Efficient algorithm
- ETL certification



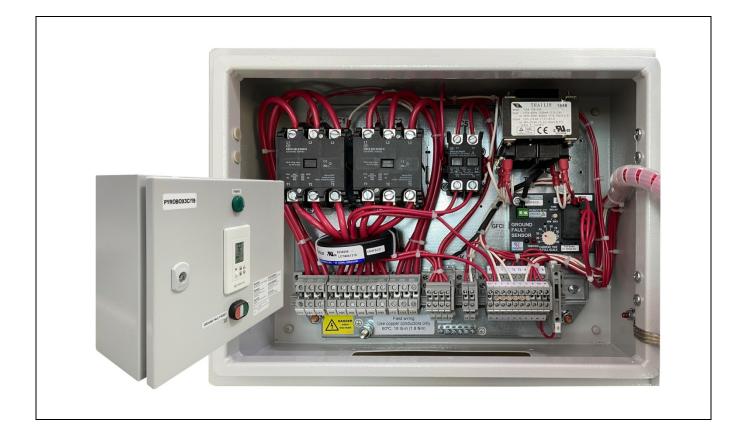

Description

The PYROBOX3C/19 is a "Plug and Play" controlled power distribution panel for frost protection, ice and snow melting applications.

It is equipped with built-in communication interface to Building Management System (B.M.S. or B.A.S.) and Smart-Home applications using RS485 connection by BACNET and MODBUS protocols.

When receiving a signal from the snow sensor/s, it activates the contactors energizing the heating elements. Based on the DIP switches configuration, the zones are activated either continuously or in customized sequencing between the zones.

The outdoor temperature set-point as well as ground upper limit temperature and ambient lower limit temperature can be easily set. The Technician Settings mode allows installer or technician to adjust the parameters for customized installations.

The parameters that can be modified are as follow:

- Temperature set-point
- Lower ambient temperature limit
- Slab Upper Temperature Limit to deactivate heaters for Energy Efficiency
- Time delay (Hold-on) before deactivating the heaters
- ON time for Manual mode
- Heaters cycle time / Splitting time between zones
- Number of zones and sequence of operation (Sensors and heaters control logic)

The PYROBOX3C/19 Built-in Ground Fault interuptor allows settings for the tripping current between 0.01 - 0.1A. The GFEP adjustable time delay provides a simple and safe protection from nuisance tripping.

DIP Switches located on the controller provide easy access to technician mode and to the system configuration settings.

The PYROBOX3C/19 allows snow sensors input both from the PYRO Snow sensors (aerial, ground and gutter – separately or any combination between them) and also from a 3rd party sensor or input.

Installing the system is a quick and easy task. Apart of mounting the metal box to the wall, the installer needs only to connect the line in and line out wires in the marked terminals and the system is ready to work.


- Snow sensor RH sensitivity
- Snow detection threshold
- Number of snow sensors connected
- Critical zones setting
- Master and slave settings if more than one PYROBOX is used
- MAC Address for the MODBUS and BACNET communication

| PYROBOX3CPYROBOX3CConnecting Aerial sensorsUp to 4Up to 4Connecting ground snow sensor-Up to 2Connecting gutter snow sensor-Up to 2Connecting 3 rd party snow sensor++Connecting slab temp sensor++ | |
|--|-------|
| Connecting ground snow sensor-Up to 2Connecting gutter snow sensor-Up to 2Connecting 3 rd party snow sensor++ | 19 |
| Connecting gutter snow sensor-Up to 2Connecting 3 rd party snow sensor++ | |
| Connecting 3 rd party snow sensor + + | |
| | |
| Connecting slab temp sensor + + | |
| | |
| Critical zones - + | |
| Master and Slave Settings - + | |
| Connection to Smart-Home / BMS - + | |
| ETL certification (US and Canada) + + | |
| Connection to mobile App - + (with Wi-Fi mo | Jule) |
| GFEP Test button Inside Outside (on do | or) |

Comparison table between PYROBOX3/19 the PYROBOX3



General system layout

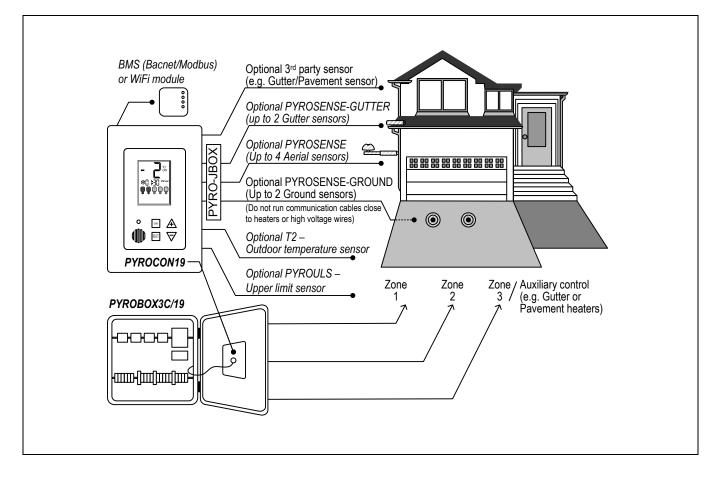


Technical specifications

| Approvals | ETL Listed CAN/CSA-C22.2 No. 14 | Manual Reset GFEP | Push button on Front Panel |
|-----------------------------|------------------------------------|----------------------|---------------------------------|
| | UL-508A | | |
| | | Two Satellite | 600 VACS, 50 A Max |
| Enclosure Protection | IP20, Indoor Mounting | Contactors | (Resistive), 50/60 Hz, 3-Poles |
| Dimensions | 11.8x15x6.1" (30x38x15.5 cm) | One Satellite | 277 VAC, 30 A Max (Resistive), |
| | | Contactor | 50/60 Hz, 1-Pole |
| Ground Fault | Adjustable trip current 0.1-1 A | | 600 VAC / 50 A per pole |
| Equipment Protection | (default 0.2A) | | |
| GFEP | Adjustable time delay | Terminal blocks | 6 mm ² ,10 AWG (max) |
| | 0.1-1 sec. (default 0.1 sec.) | | |
| | | | |



Wiring diagram

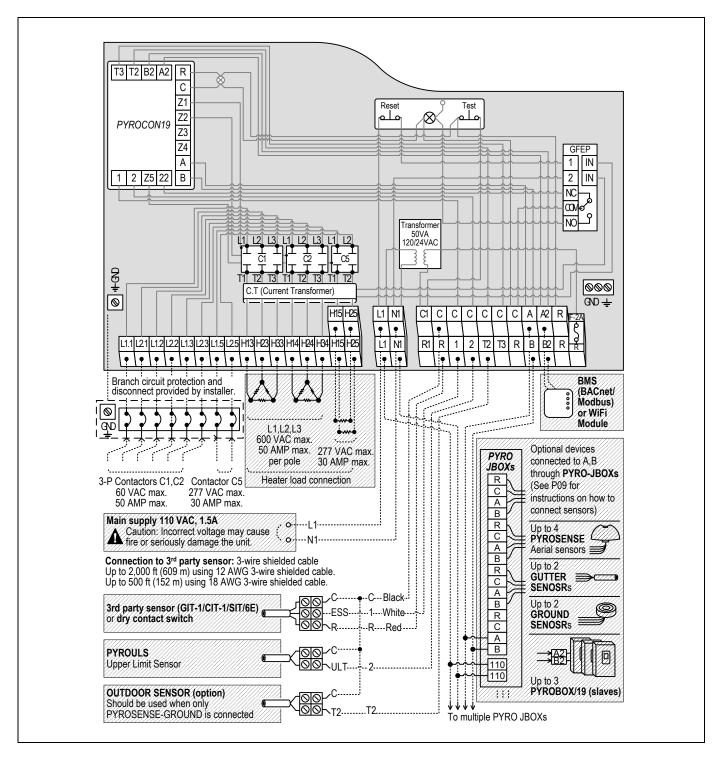

For further information, operating & installation manual, please refer to our website at www.meitavtec.com

The performance specifications are nominal and conform to acceptable industry standards. For applications at conditions beyond these specifications, consult the local Meitav-tec office or representative. Meitav-tec shall not be liable for damages resulting from misapplication or misuse of its products.

This document is subject to change without any notice.

© Copyright 2020 Meitav-tec Ltd'. All rights reserved.